


PLAN VIEW

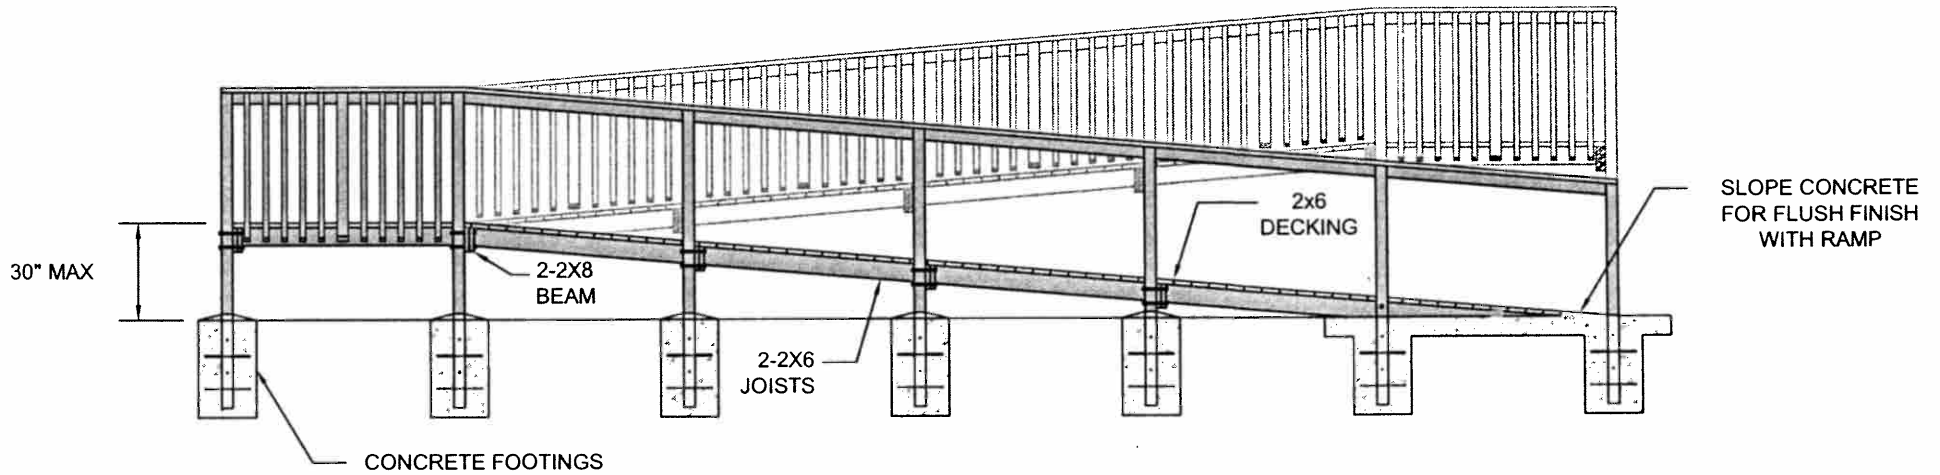

ELEVATION

GENERAL NOTES:

1. Use treated # 2 S.Y.P. or equal.
2. Concrete compressive strength @ 28 days = 2500 psi.
3. Guards shall be located along ramps & landings that are located more than 30" above grade below.

CITY OF HOUSTON	
Department of Public Works and Engineering	
COMMERCIAL RAMP & LANDING	
APPROVED BY: <i>Ray Bush</i> BUILDING OFFICIAL	APPROVED BY: <i>Mark H. Both</i> CITY ENGINEER
DATE: 10 / 08 / 09	DWG No.: 08C07-1
1 of 2	