


TWO STORY

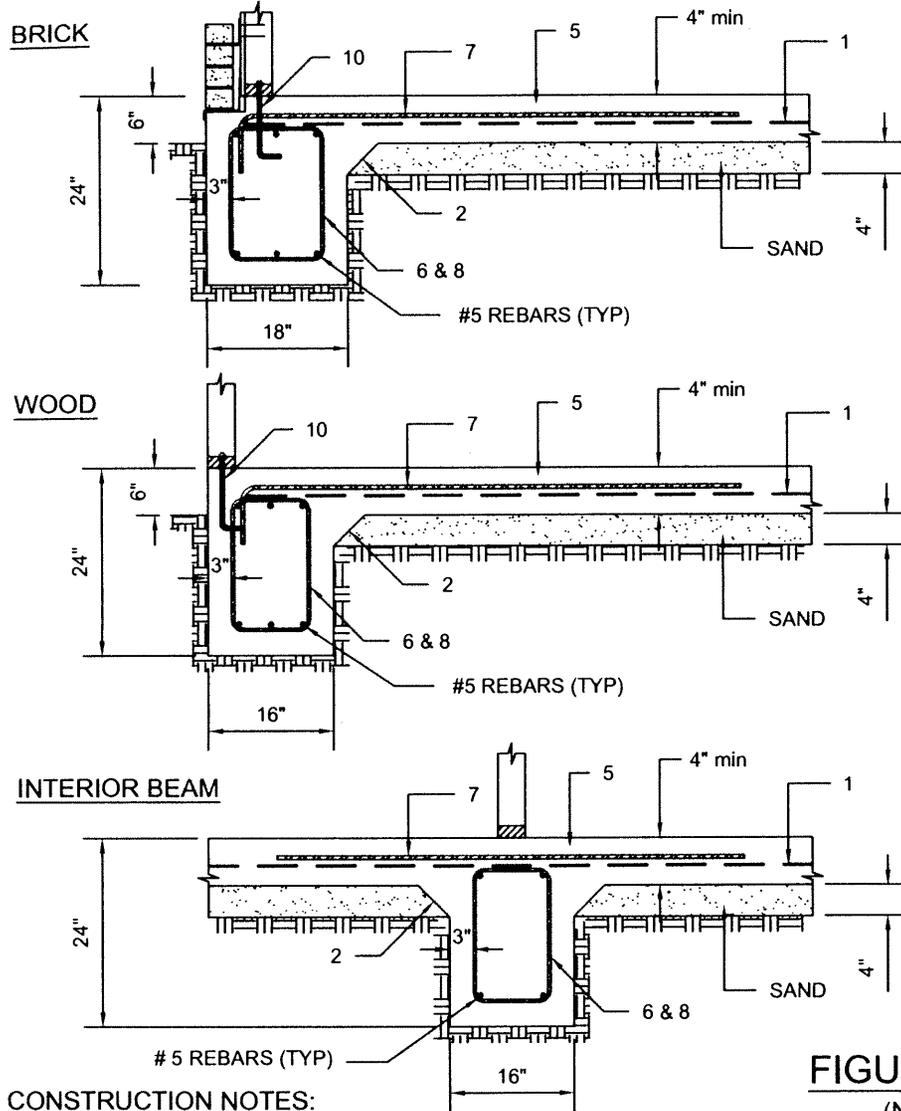

ONE STORY

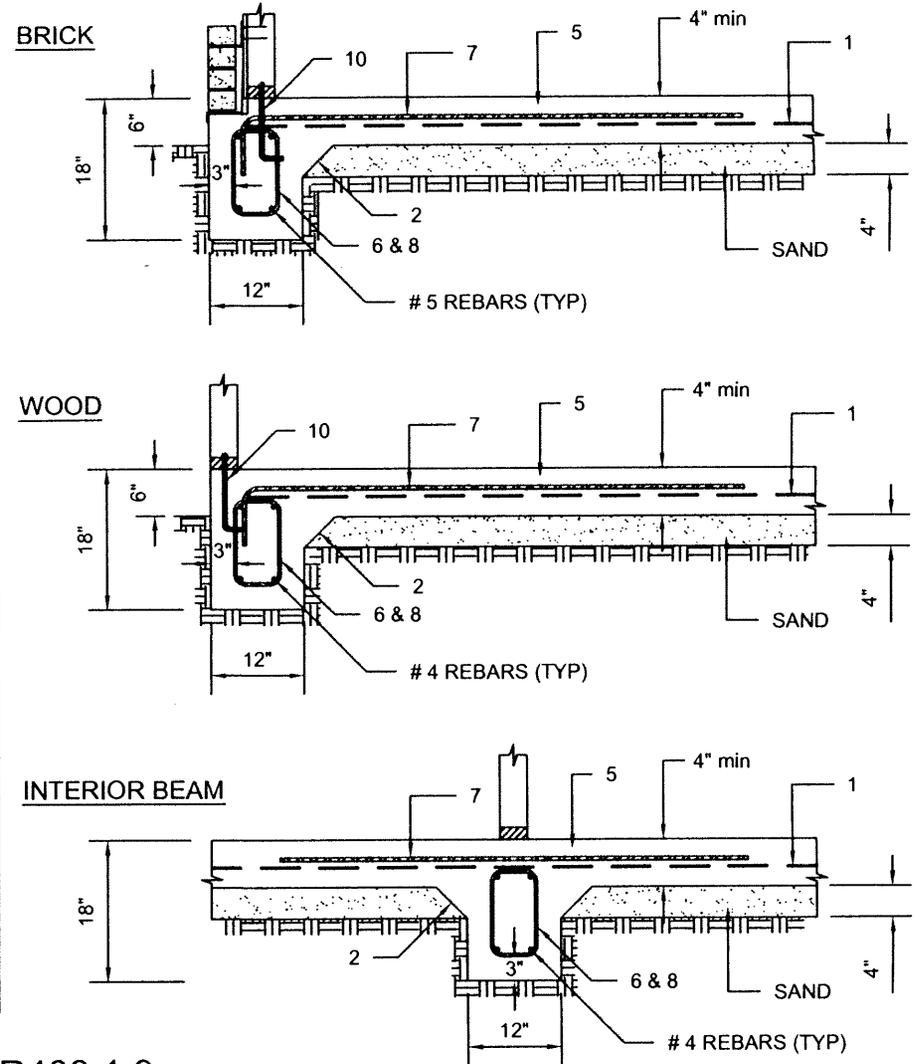


FIGURE R403.1.9

(Not To Scale)

CONSTRUCTION NOTES:

1. All slabs shall be reinforced with #6 web wire mesh 6"x6" min.
2. All house slabs shall have a 6 mil vapor barrier using poly or other approved material.
3. All slabs shall be a minimum of 4" thick with a 4" sand cushion.
4. Concrete shall have a minimum of 2500 psi in 28 days.
5. Steel shall be covered with 2" of concrete.
6. Stirrups to be #3 rebars @ 18" O.C.
7. Shear reinforcing at intersection of slab and all beams to be #4 rebar, 5' long, 5' on center.
8. Steel shall be covered with 3" of concrete.
9. Interior beams every 20 linear ft. or under bearing partition.
10. 1/2" anchor bolts, 10" long. Extend a minimum of 7" into concrete.

CITY OF HOUSTON

Department of Public Works and Engineering

FOUNDATIONS FOR ADDITIONS

DATE: 12 / 29 / 09 DWG No: 09R15

1 of 1

