



SECTION A-A

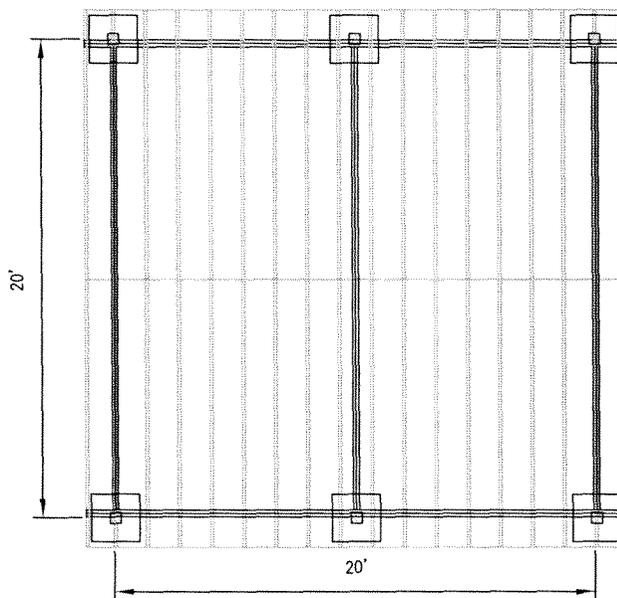

ROOF / FOUNDATIONS PLAN

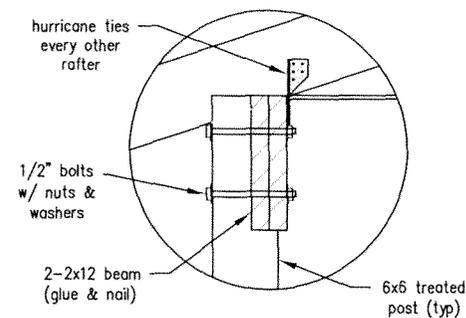

NOTES:

1. Use #2 S.Y.P. or higher grade wood.
2. Concrete shall have a minimum compressive strength of 2500 psi @ 28 days.
3. Allowable soil bearing pressure is assumed to be 1500 psf.
4. Use ASTM A615 grade 60 reinforcing steel.
5. Reinforcing steel shall have 3" of cover.
6. For slopes > or = 4:12, 1 layer of 15 lb felt.  
For slopes from 2:12 to 4:12, 2 layers of 15 lb felt.  
For slopes < 2:12, the use of asphalt shingles is not allowed.

<p><b>CITY OF HOUSTON</b> Department of Public Works and Engineering</p>	
<p><b>WOOD SHADE STRUCTURE</b></p>	
<p>Approved by: <i>Mark Spivey</i> Building Official</p>	<p>Approved by: <i>[Signature]</i> City Engineer</p>
DATE: 2/7/2012	DWG No.: 10-08-R
1 of 1	