



SECTION

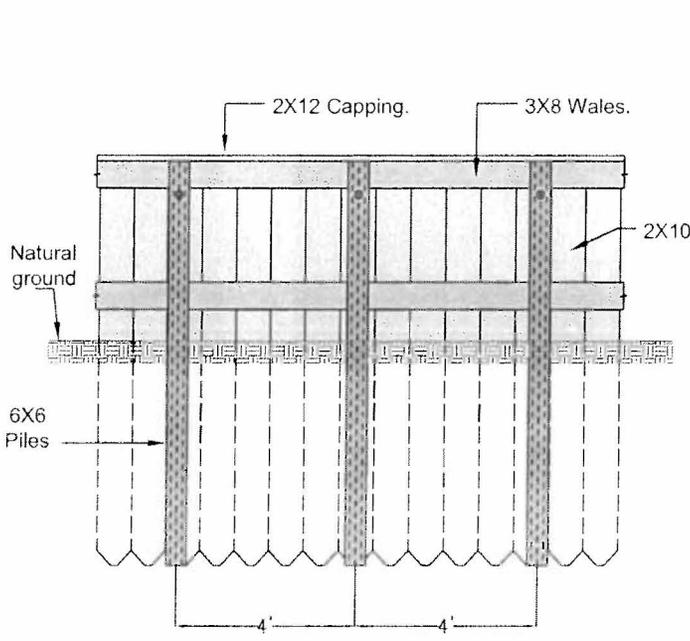

ELEVATION

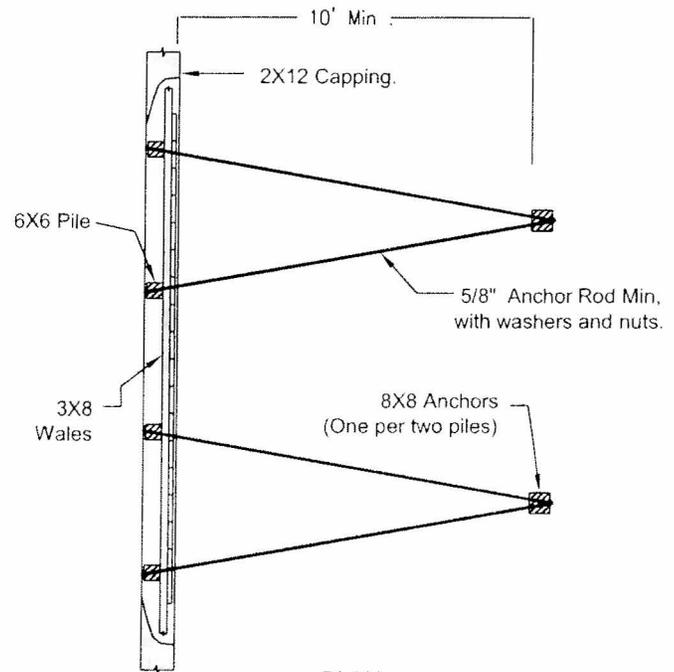

PLAN

Notes:

1. Wood shall be treated in accordance with AWPA U1, Use Category UC5C, Marine Use Southern Waters.
2. Use # 1 treated lumber.
3. Anchor rods shall be coated with rust resistant marine coatings within 4' of the bulkhead.
4. Bulkheads shall be subject to periodic inspections and maintenance.
5. No surcharge load is allowed.
6. Cracks between vertical members shall not exceed 1/8 inch.
7. No net fill below Base Flood Elevation is permitted in the flood plain. Dispose of spoils outside of the flood plain.
8. No fill material shall be imported to flood plain.

CITY OF HOUSTON

Department of Public Works and Engineering

RESIDENTIAL 4' WOOD BULKHEAD

Approved by: *[Signature]*
Building Official

Approved by: *[Signature]*
City Engineer

REVISION DATE: 7-9-2013

DWG No. 11-04-R (Revision 1)

1 of 1