
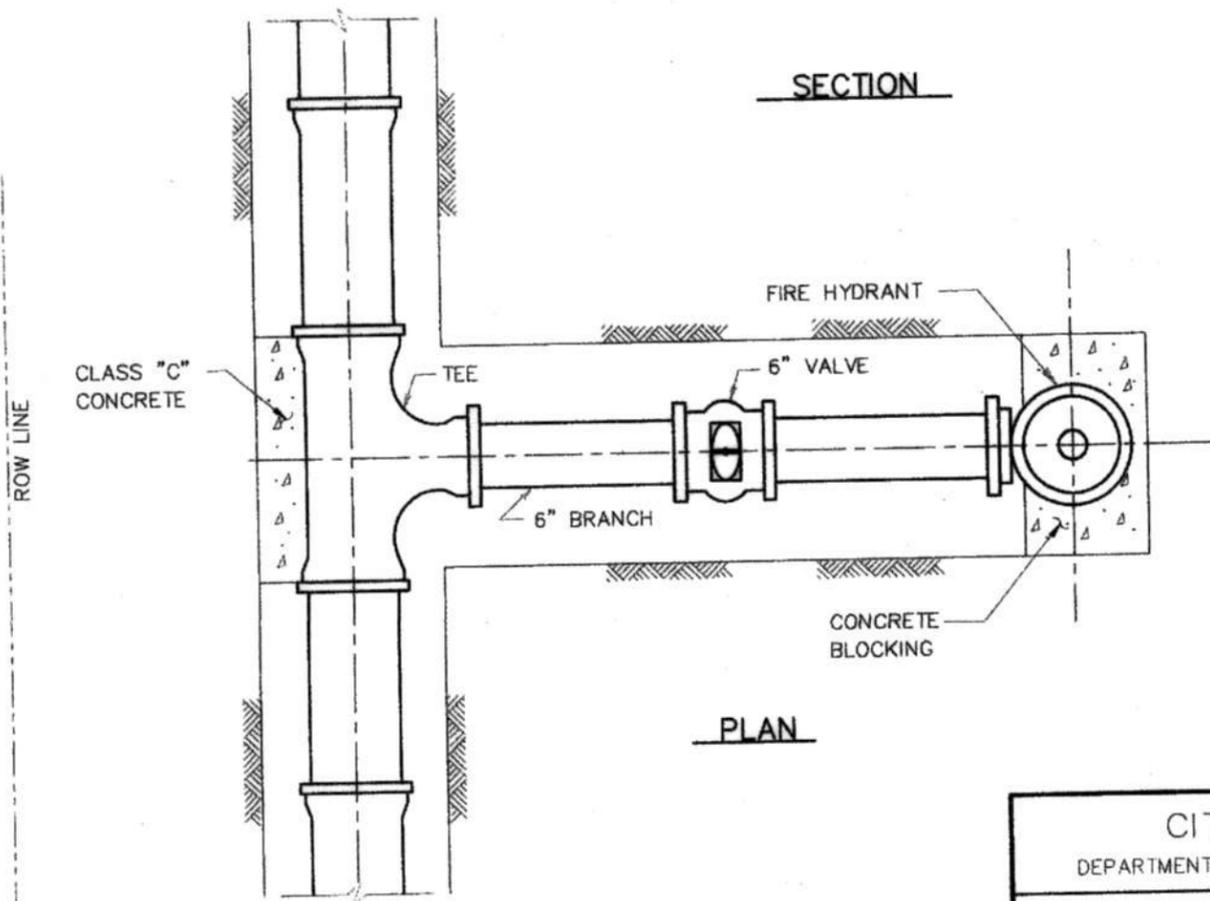
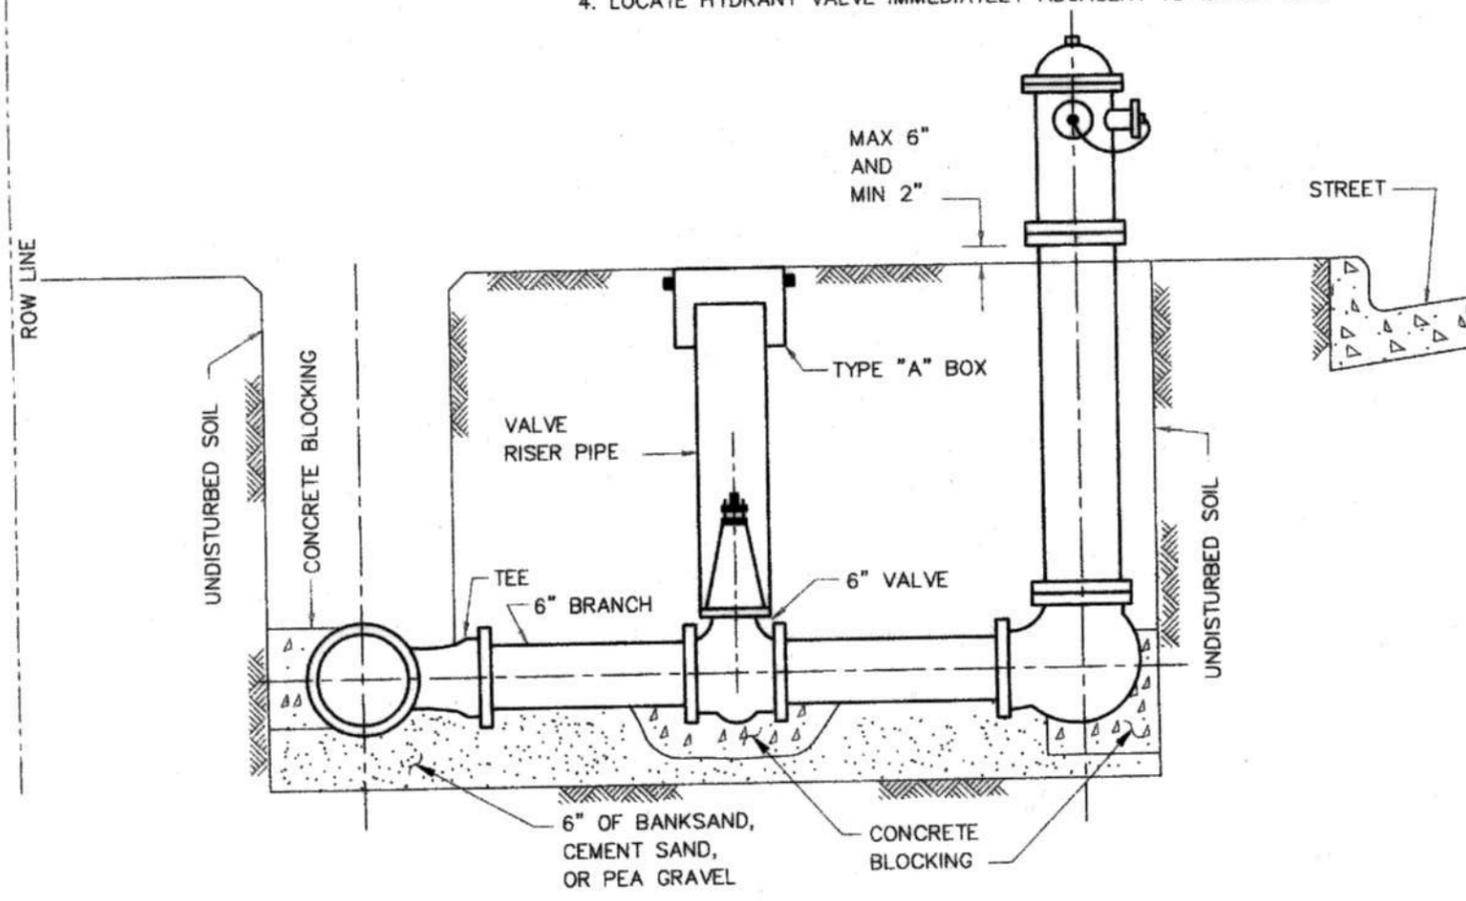


NOTES:

1. LOCATE FIRE HYDRANTS AT PCs OF THE INTERSECTION CURB RADIUS, 3 FEET BEHIND CURB OR PROJECTED FUTURE CURB.
2. ON OPEN-DITCH ROADWAYS, SET THE FIRE HYDRANTS WITH IN 5 FEET OF RIGHTS-OF-WAY LINES.
3. FIRE HYDRANT STEAMER NOZZLE SHALL FACE THE STREET.
4. LOCATE HYDRANT VALVE IMMEDIATELY ADJACENT TO WATER LINE.



CITY OF HOUSTON DEPARTMENT OF PUBLIC WORKS AND ENGINEERING	
STANDARD FIRE HYDRANT DETAIL (NOT TO SCALE)	
APPROVED BY  CITY ENGINEER	APPROVED BY  DIRECTOR OF PUBLIC WORKS AND ENGINEERING
EFF DATE: JULY-01-2010 DWG NO: 02520-01	