
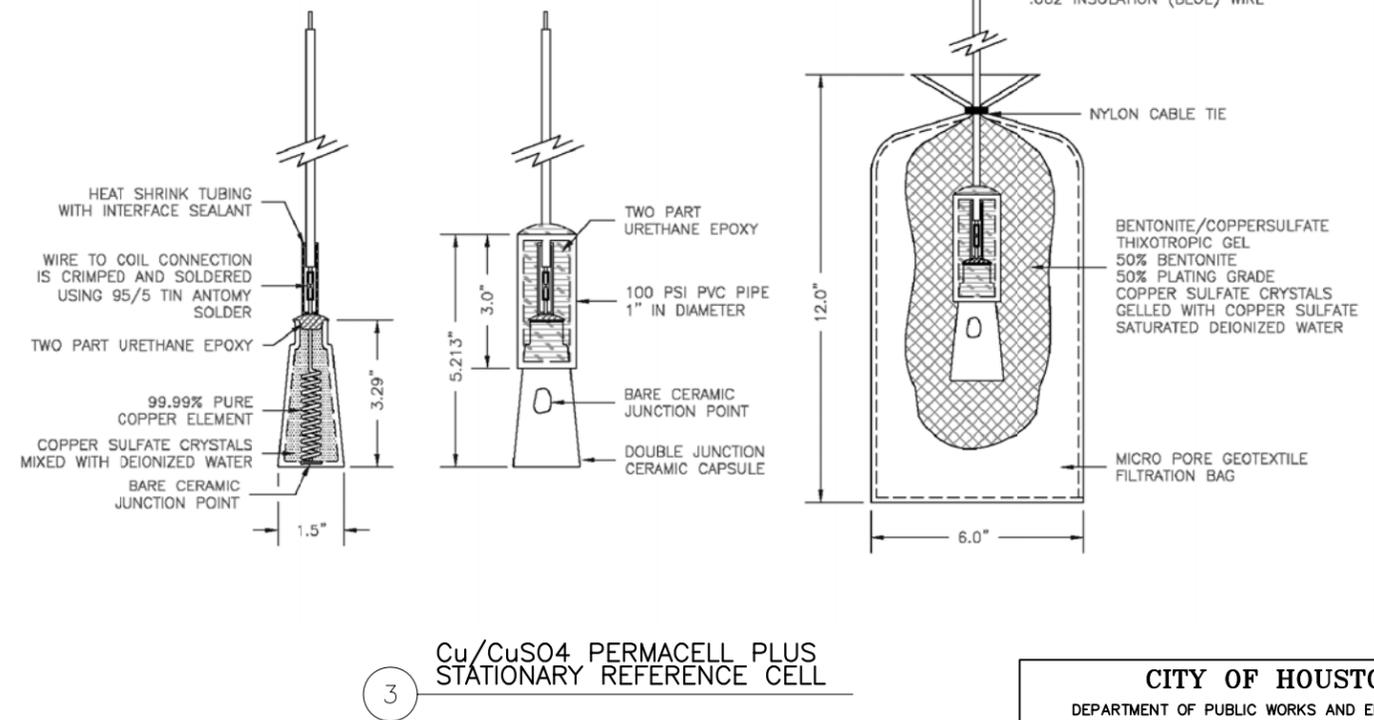
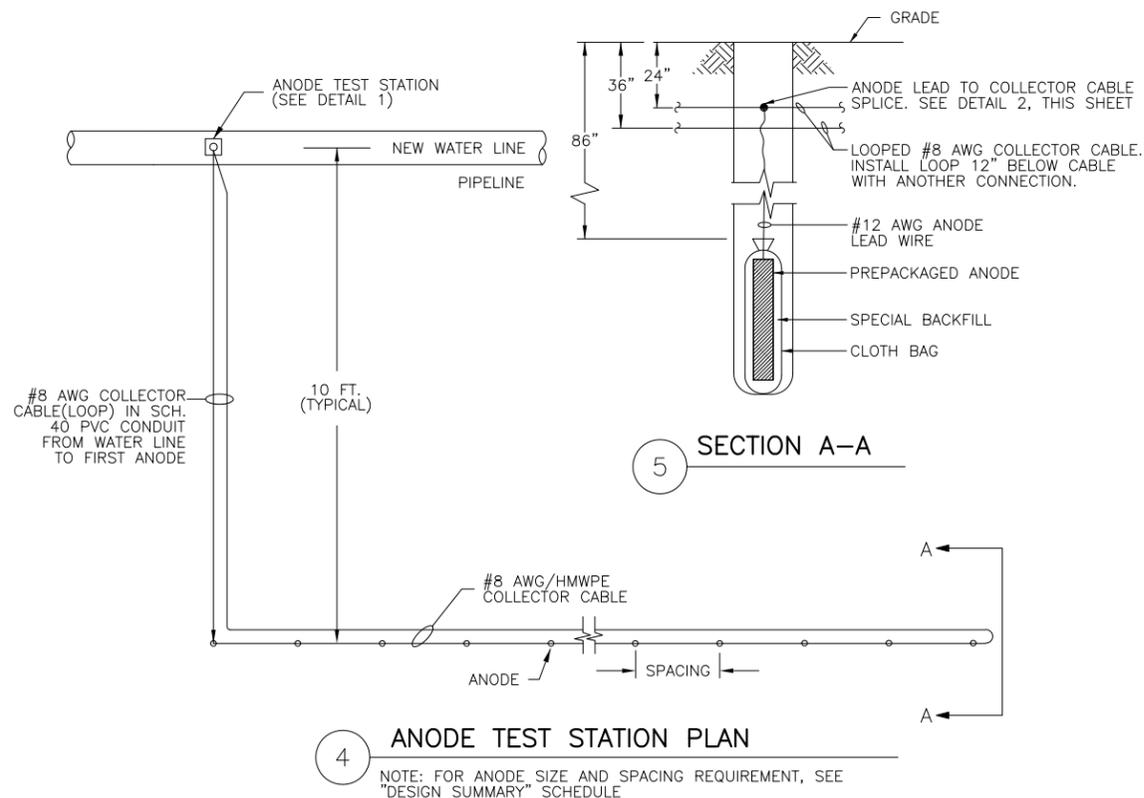
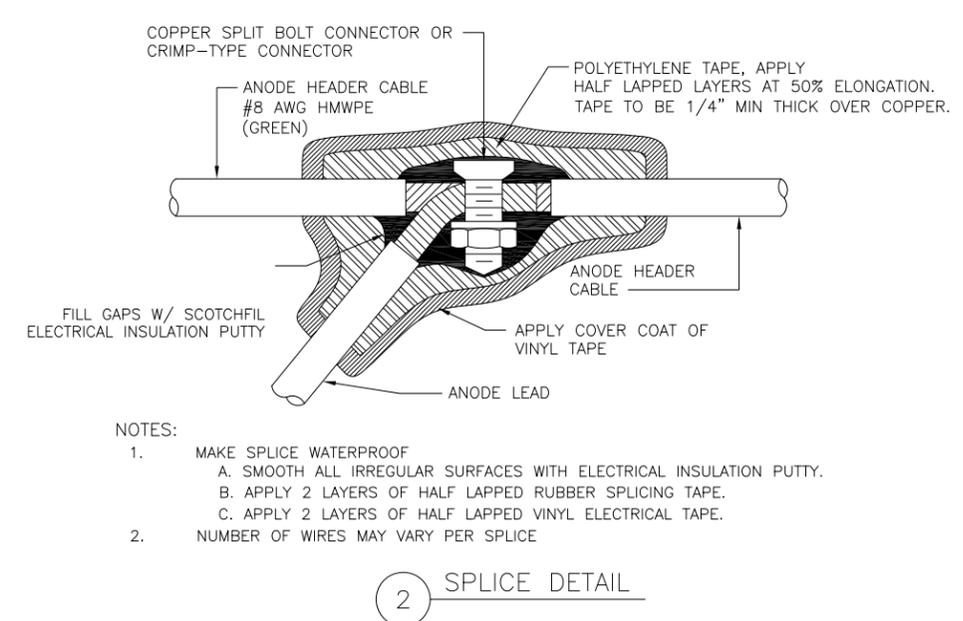


WIRE CODING:
 * WIRES A & B ARE WHITE
 * WIRES A & B ARE #12 AWG TW SOLID SINGLE CONDUCTOR WIRE
 * WIRE C IS BLUE #14 AWG/HMWPE LEAD WIRE TO REFERENCE ELECTRODE
 * WIRE D & E ARE GREEN #8 AWG ANODE LEAD WIRE TO ANODE GROUND BED

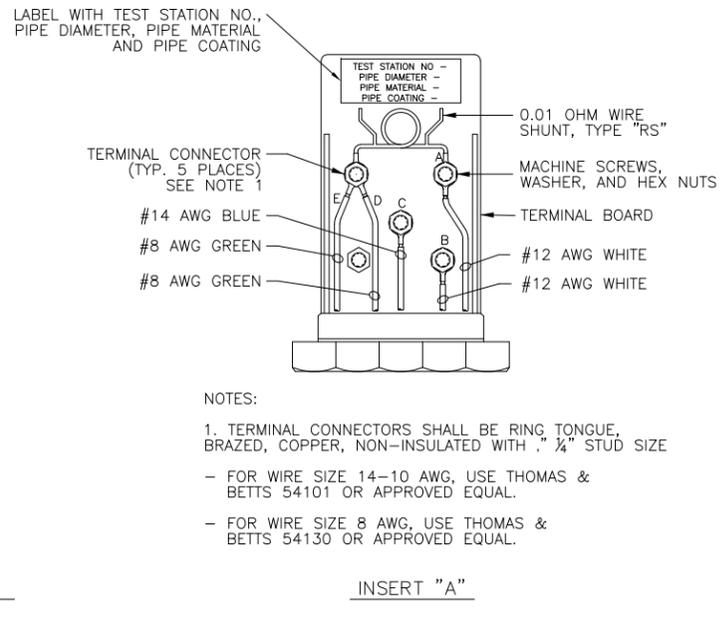

CITY OF HOUSTON	
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING	
STANDARD LDWL CATHODIC PROTECTION DETAILS FOR TEST STATIONS ANODES	
(NOT TO SCALE)	
APPROVED BY:	APPROVED BY:
CITY ENGINEER	DIRECTOR OF PUBLIC WORKS AND ENGINEERING
EFF DATE: NOV-10-2016	DWG NO: